

11. Gas and Electric Meters at One Location

Both the-gas and electric meters should normally be located on the same side of the building.

If the customer is to be served with an electric underground service in a joint trench, the gas and electric meters shall be at the same location preferably on the outside of the building and as indicated in the Electric Metering, General, Section of this book and Figure 19 below. Separation between gas and electric meters must be in compliance with local ordinances.

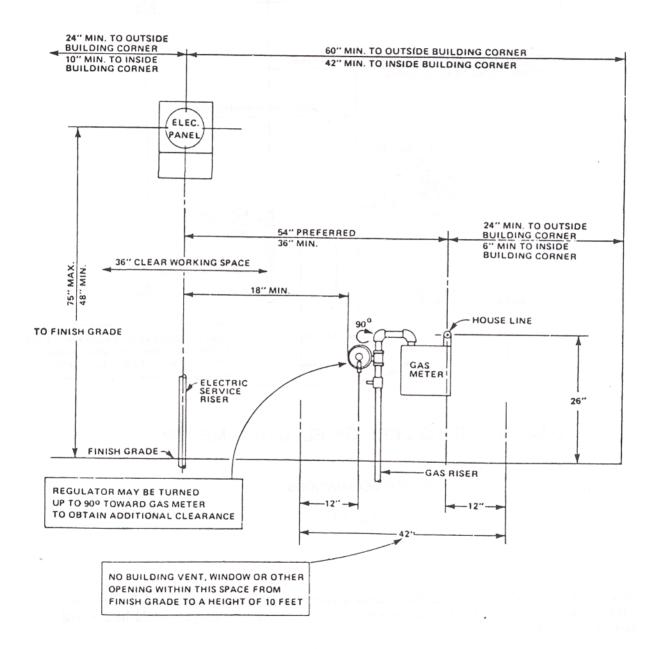

GAS METER TO RIGHT OF ELECTRIC METER

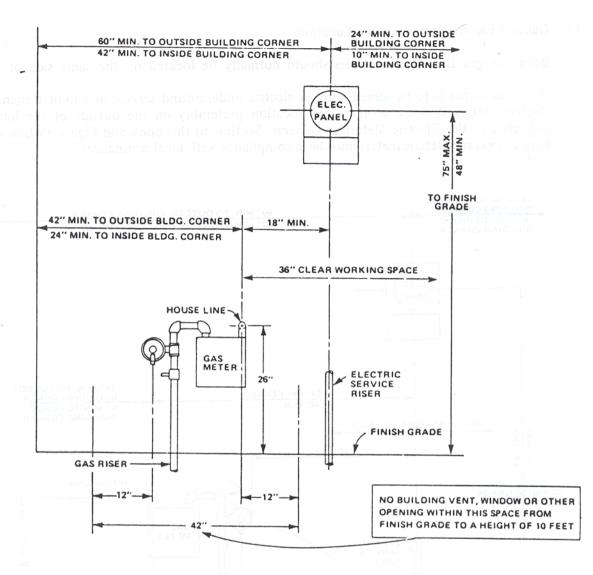

GAS METER TO LEFT OF ELECTRIC METER

METER SEPARATIONS

Fig. 19

NOTES:

- 11.1-1 PGandE will install a 3/4 inch, 90 degrees screened fitting on each internal relief valve (IRV) regulator and the fitting will be positioned such that vented gas would be directed away from the building.
- 11.1-2 Local ordinances prevail if greater clearances than herein specified are required.